

CORRIGENDUM-II

12 October, 2016

Ref. Tender No. BGL/327/2016-17 dated.21.09.2016

Sub: Tender for Rate Contract for Mechanical & Electrical works for construction of CNG DBS & Online Stations in Hyderabad, Vijayawada & Kakinada.

This is for general information to all bidders that following details enclosed herewith shall form part of the bidding documents.

This is for general information to all bidders:

Sr No	Section	Bid Document Description	Bidders Queries	BGL Responses
Commercial Query				
1	Vol II of II, Section-9 SOR (Page 44 of 66)	SOR item no:3	RCC Reinforcement is included, Steel requirement may be provided for arriving estimation	As per standard practise, maximum weight of steel to be used is 2% of weight of Concrete, same shall be considered for arriving estimation.
2	Vol II of II, Section-9 SOR (Page 47 of 66)	SOR item no:1.b.i)	3.5Core X120Sq.mm Armoured copper not available in the market	To be read as 4 Core x 120 Sq.mm Armoured copper
3	Vol II of II, Section-9 SOR (Page 47 of 66)	SOR item no:1.b.ii),iii),iv)	Aluminium cables for such sizes are not available in the market	To be read as Copper cables of mentioned sizes of respective SOR items
4	Vol II of II, Section-9 SOR (Page 47 of 66)	SOR item no:1.b.ix)	Type of cable not mentioned except size	Copper cable of size as mentioned in SOR item

Dy. Manager (Commercial) Projects
BHAAGYANAGAR GAS LTD
2nd Floor, Plot No. 14,
Beshcherpet, Hyderabad - 500014.

5	Vol II of II, Section-9 SOR (Page 48 of 66)	SOR item nos: 2.1 & 2.2	Panel drawing and size specification not mentioned	Enclosed as Annexure-I
6	Vol II of II, Section-9 SOR (Page 49 of 66)	SOR item nos: 5	Drawing not provided for IS:3043 earthing	Enclosed as Annexure-II
7	Vol II of II, Section-9 SOR (Page 49 of 66)	SOR item nos: 7	Shunt trip coil in item no: 4 to be provided	To be read as item no 2.1 & 2.2 of SOR
8	Vol II of II, Section-9 SOR (Page 49 of 66)	SOR item nos: 11	Thickness of Pipe not mentioned	PVC pipe to be used for cable conduiting shall be as per standard practise of Electrical cable laying
9	Vol II of II, Section-9 SOR (Page 51 of 66)	SOR item nos: D.a)	Size of the frame not mentioned	Frame shall be made of 25mmx3mm flats of frame sizes as per BGL requirement which shall be intimated during execution.
10	Vol II of II, Section-9 SOR (Page 48 of 66)	SOR item nos: 2.1	supply, erection and commissioning of sub distribution board with incomer 125 Amp , 4P MCCB and outcomer having one number 100 Amp DP MCB (Make of SWITCHGEAR should be of L&T or LEGRAND or CG), the panels must be provided with a suitable emergency shutdown button which can be fixed at outside the control room and near to the sales/dealer room, jobs must include all the accessories required for connecting the required load details given alongwith SOR as directed by EIC.	To be read as supply, erection and commissioning of sub distribution board with incomer 125 Amp , 4P MCCB and outcomer having one number 100 Amp, 4P MCCB and 02 no's (Two) numbers of 10 Amp DP MCB, 01 no's (One) 16 Amp, 4P MCB (Make of SWITCHGEAR should be of L&T or LEGRAND or CG), the panels must be provided with a suitable emergency shutdown button which can be fixed at outside the control room and near to the sales/dealer room, jobs must include all the accessories required for connecting the required load details given alongwith SOR as directed by EIC.

Dy. Mansoor (Contract & Procurement)
 MANSOOR & CO. LTD.
 10, Mansoor Bhawan

	2.2	<p>supply, erection and commissioning of sub distribution board with incoer 400 Amp, 4P MCCB and four numbers of 10Amp DP MCB (Make of SWITCHGEAR should be of L&T or LEGRAND or CG), the panel should have Ammeter(o-500/5Amps), Voltmeter(0-500V) with selector switches. The panels must be provided with a suitable emergency shutdown button which can be fixed at outside the control room and near to the sales/dealer room jobs must include all the accessories required for connecting the required load details given alongwith SOR as directed by EIC</p>	<p>To be read as supply, erection and commissioning of sub distribution board with incoer 400 Amp, 4P MCCB and 02 no's of 10Amp DP MCB, 01 no's of 32Amp 4P MCB (Make of SWITCHGEAR should be of L&T or LEGRAND or CG), the panel should have Ammeter(o-500/5Amps), Voltmeter(0-500V) with selector switches. The panels must be provided with a suitable emergency shutdown button which can be fixed at outside the control room and near to the sales/dealer room jobs must include all the accessories required for connecting the required load details given along with SOR as directed by EIC</p>
--	-----	---	--

Bidder shall take in to account the above while submitting their bid.

**The Corrigendum – I shall form the integral part of the tender document.
All other Terms and Conditions of the tender document shall remain unaltered.**

For and on Behalf of
M/s. Bhagyanager Gas Limited




**Bonny K Joseph
Dy. Manager (C&P)**

Dy. Manager (Contracts & Procurement),
BHAGYANAGAR GAS LTD,
2nd Floor, Parisaram Bldg, Van,
Bashierbagh, Hyderabad-500 004.

CORRIGENDUM-II

Tender No. BGL/327/2016-17 dated.21.09.2016

Annexure: I

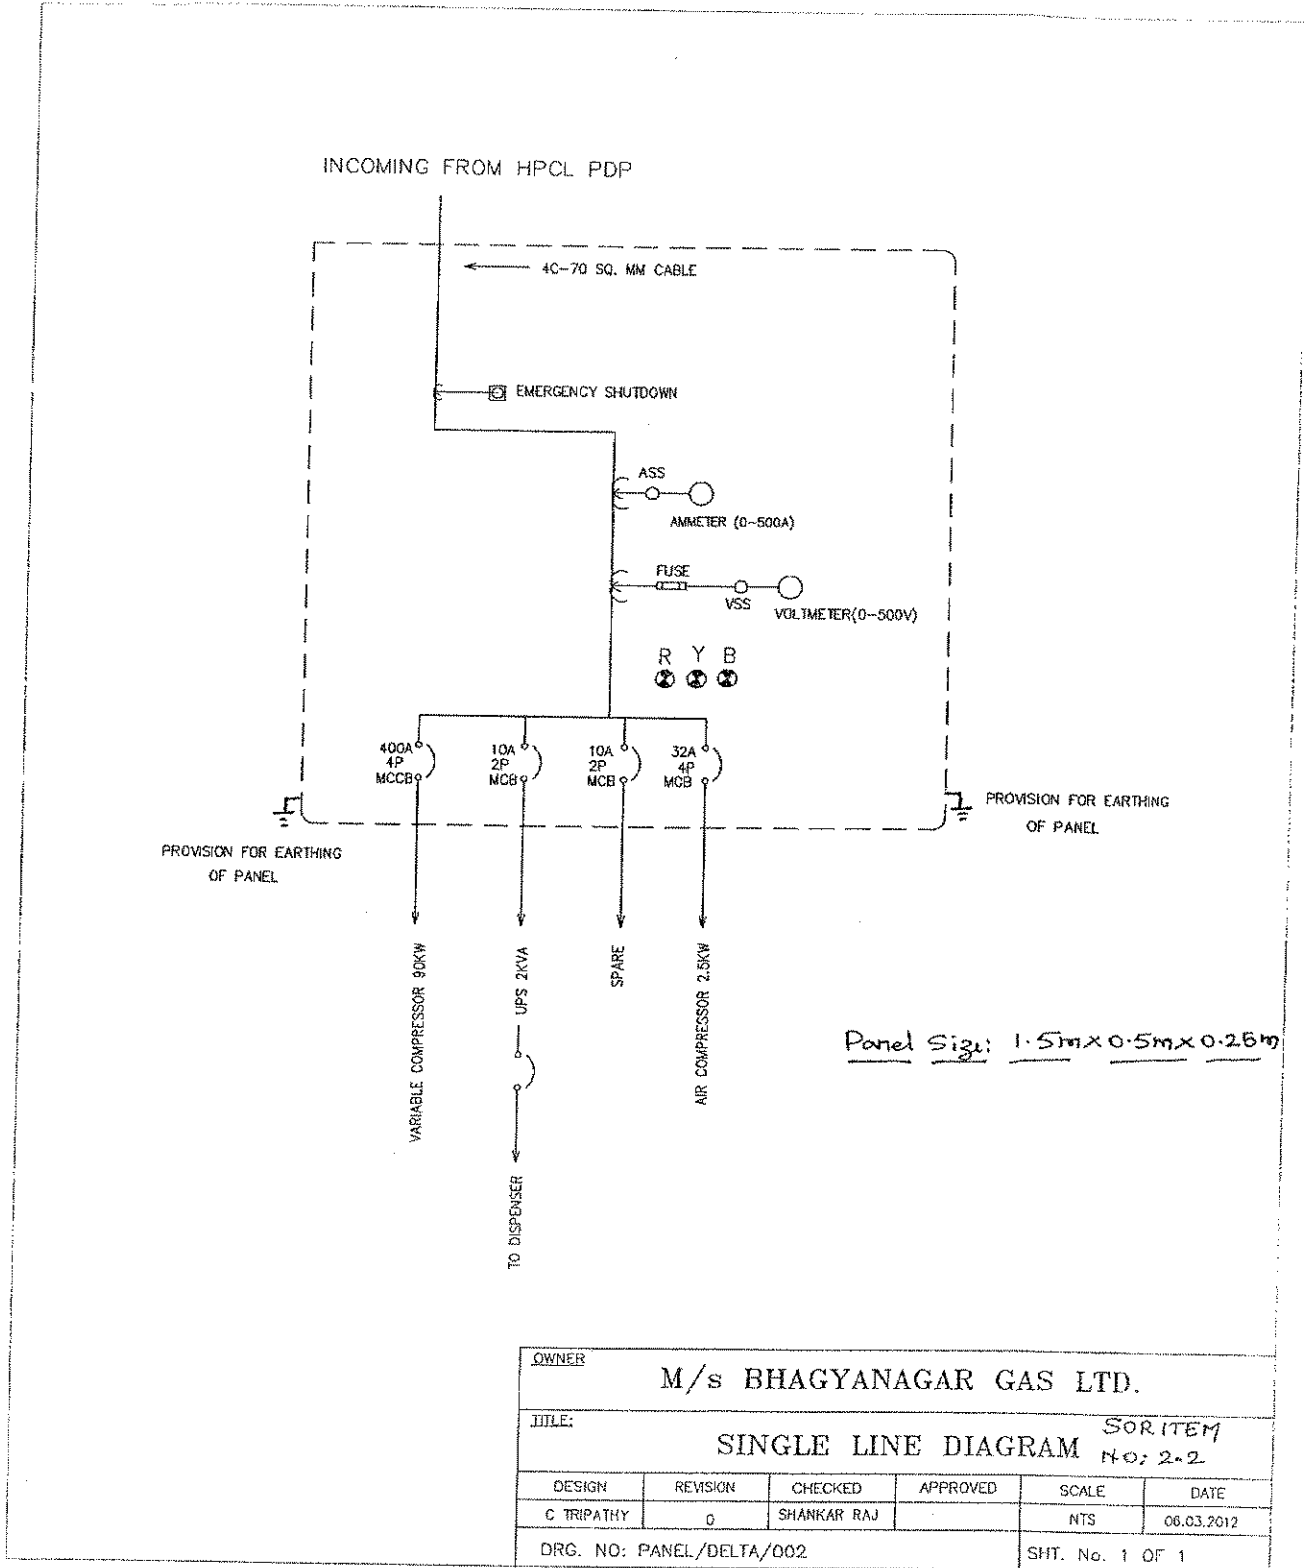

OWNER					
M/s BHAGYANAGAR GAS LTD.					
TITLE:					
SINGLE LINE DIAGRAM					
SOR ITEM NO: 2-2					
DESIGN	REVISION	CHECKED	APPROVED	SCALE	DATE
C TRIPATHY	0	SHANKAR RAJ		NTS	06.03.2012
DRG. NO: PANEL/DELTA/002				SHT. No. 1 OF 1	

Dy. Manager (Commercial) *[Signature]*
 BHAGYANAGAR GAS LTD.
 2nd Floor, Park Street, Hyderabad-500 004
 Basheerbagh, Hyderabad-500 004


12/10/16

Page 4 of 6

CORRIGENDUM-II

Tender No. BGL/327/2016-17 dated.21.09.2016

Annexure: I

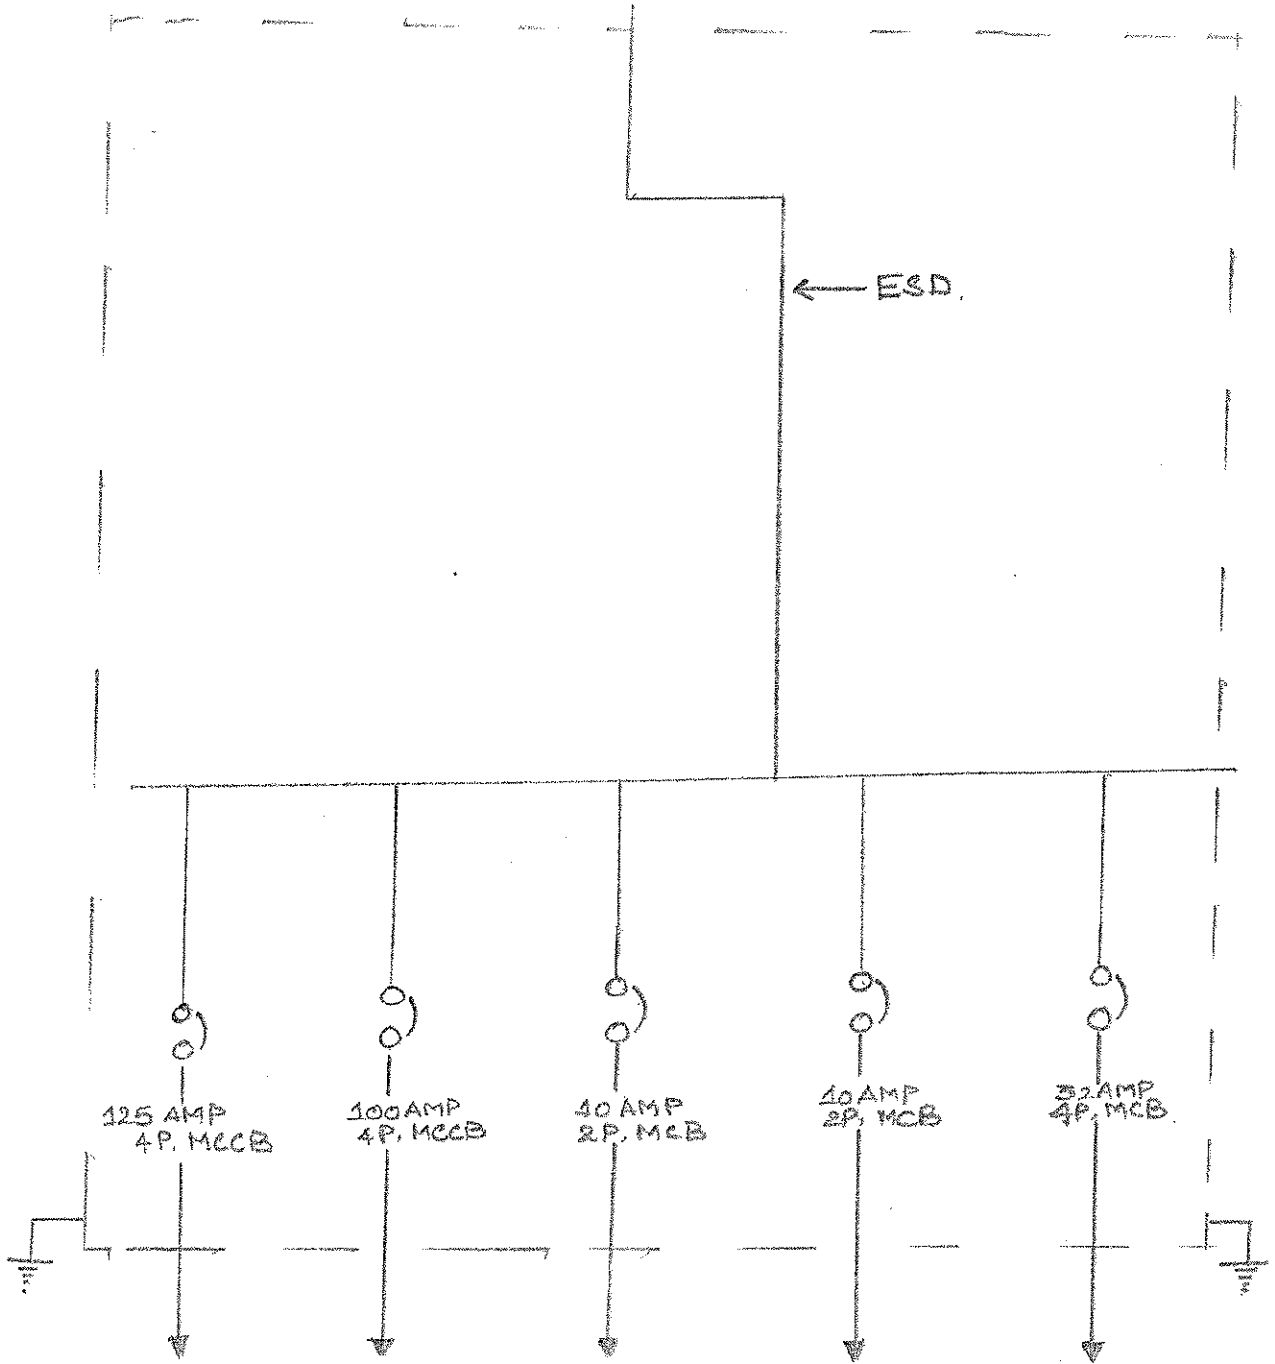

PANEL SIZE : 0.6m X 0.6m X 0.2m
SLD FOR SOR ITEM NO. 2.1.


Dy. Manager (E) *[Signature]*
BHAGYANATH
2nd Floor, Panabrahma
Basheerbagh, Hyderabad - 500 004. Page 5 of 6

CORRIGENDUM-II

Tender No. BGL/327/2016-17 dated.21.09.2016

Annexure: II

DRAWING FOR EARTHING SYSTEM

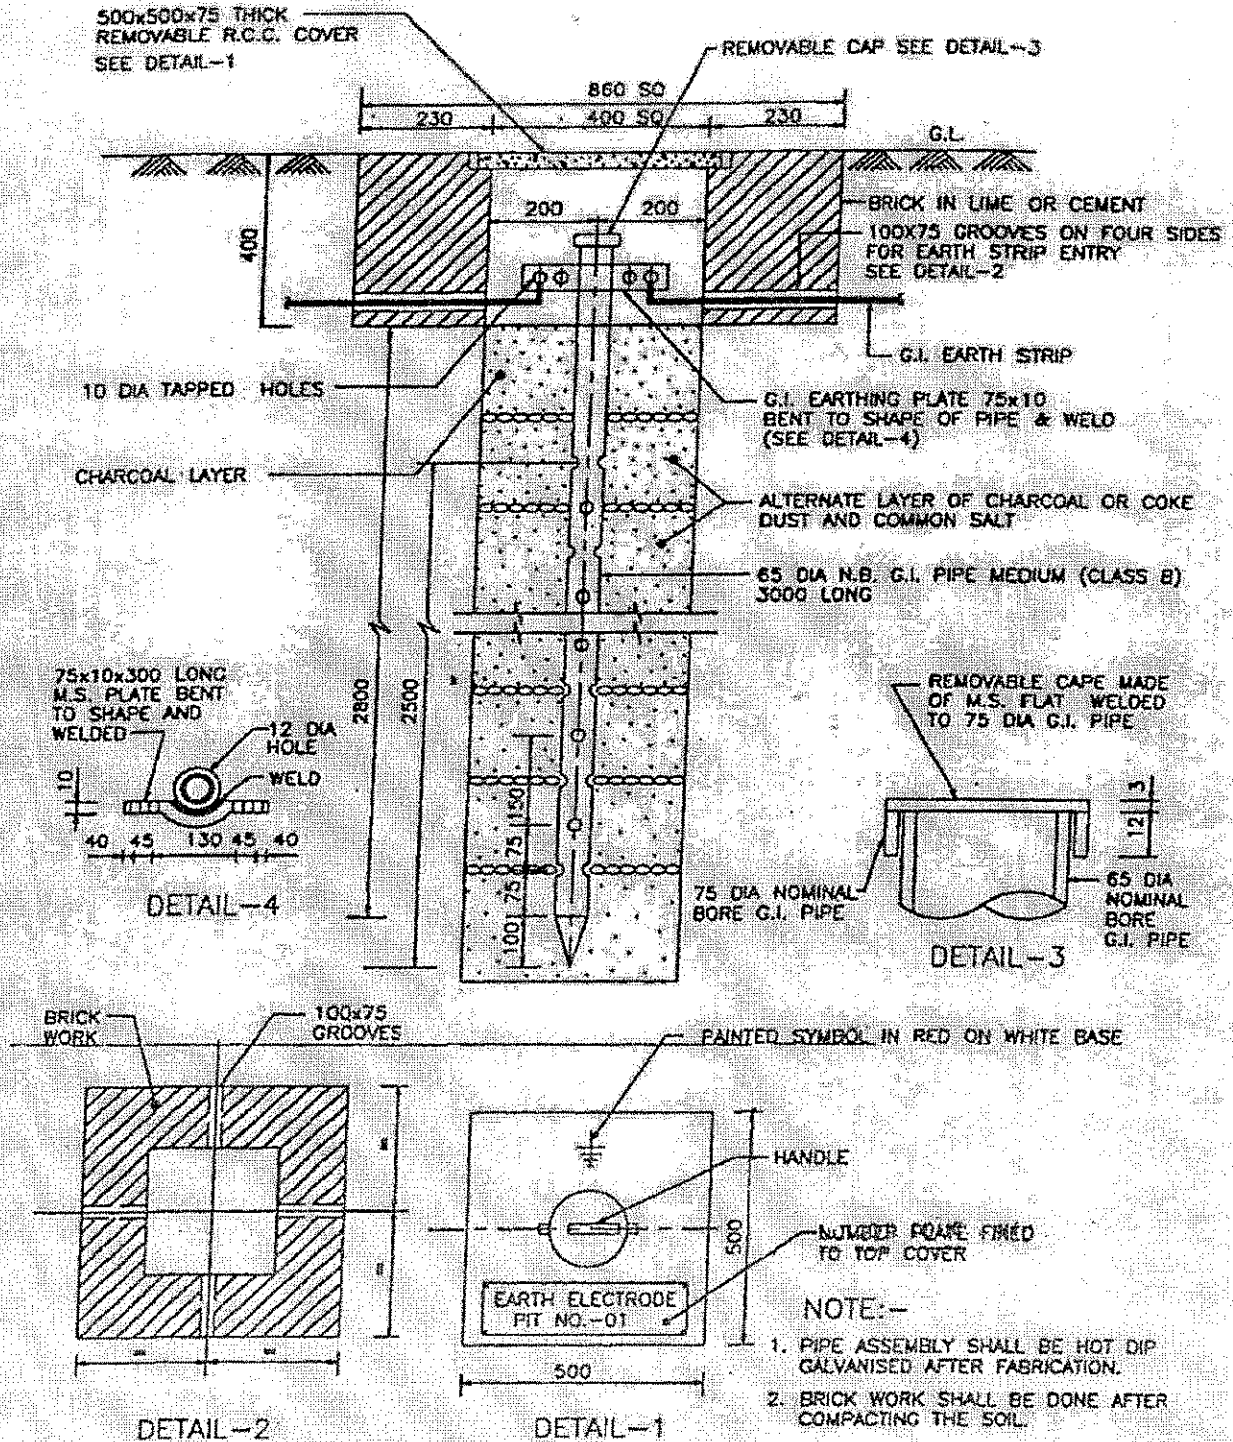

Dy. Manager (C)
BHAGYALAKSHI
2nd Floor, Basheerabad
Basheerabad, Hyderabad-500046

Page 6 of 6